



**7 EARTHWORK**

- Subgrading**
- Achieve building subgrades with smooth blade equipment to reduce disturbance to the site soil.
  - If the subgrade surface exhibits disturbance, is pumping or rutting, soft, wet or frozen, the surface must be moisture conditioned and recompacted to at least 95 percent of ASTM D1557 (Modified Proctor).
  - Do not interrupt subsurface trench drains traversing this lot during earthwork, foundation or other activities or development. If subsurface trench drain functionality is impeded, reroute, replace or repair drains to sustain continuous gravity flow of groundwater seepage around or through the lot and/or into site stormwater facilities.
  - Specific recompaction effort is required at foundation, slab, and pavement sections as outlined herein depending on the conditions encountered.
  - Areas which cannot be remediated by moisture conditioning must be removed at least 12 inches to firm, unyielding native or structural fill soil. Replace these over-excavations with granular structural fill as described in the *Structural Fill* section of sheet G2.
  - STRATA or the retained geotechnical engineer-of-record shall review all site preparations and over-excavations prior to granular structural fill placement.
  - If earthwork occurs during wet periods, accomplish work at or near final subgrades using equipment that imparts low bearing pressures, track-mounted, drum and low tire pressure equipment. Using high bearing pressure equipment such as dump trucks and scrapers can readily pump and rut the subgrade and their applications must be carefully considered.
  - STRATA or the retained geotechnical engineer-of-record shall review and approve all exposed subgrades prior to structural fill or concrete placement.

- Excavation Characteristics**
- Site soil is expected to be excavatable using conventional excavation techniques and equipment.
  - Bedrock is not expected within the planned construction limits (5 to 10 feet).
  - Temporarily excavate, slope, shore or brace excavations in accordance with *Washington Industrial Safety and Health Act (WISHA)* and *Washington Administrative Code (WAC)* guidelines. Regulations outlined in WAC Section 296-155 provide temporary construction slope requirements for various soil types and slopes less than 20 feet tall.
  - Recompacted site soil or undisturbed native clay loess is classified as *Type C* soil referencing WAC Section 296-155, and must be temporarily sloped back at least 1.5H:1V.
  - Construction vibrations, seepage, or surface loading can cause excavations to slough or cave and should be avoided.
  - Ultimately, the contractor is solely responsible for site safety and excavation configurations and maintaining WISHA approved personnel for excavation monitoring.
  - Plan excavations carefully, allowing water collection points and utilizing conventional sumps and pumps to remove nuisance water from runoff, seeps, springs or precipitation.
  - Coordinate construction activities and excavation backfilling as rapidly as possible following excavation to reduce the potential for subgrades to degrade under construction traffic.
  - Grade subgrades aggressively to direct surface water away from work areas and avoid infiltration.
  - Maintain dewatering systems to facilitate good drainage during construction and reduced over-excavation.

- Wet Weather/Soil Construction**
- Ideally, perform earthwork construction during dry weather conditions (typically June-October).
  - The site soil is susceptible to pumping or rutting from heavy loads such as rubber-tired equipment or vehicles any time of the year.
  - Complete earthwork by track-mounted equipment that reduces vehicular pressure applied to the soil if construction commences in wet areas or before soil can dry.
  - Depending on precipitation and runoff the site soil may be over optimum moisture content. Contractor shall expect these conditions and be prepared to install runoff management facilities and to replace wet or disturbed soil with granular structural fill.
  - During good weather that allows soil drying, site soil is suitable for reuse. However, during wet cool weather, site soil may not be suitable for reuse.

- Over-Excavation**
- If the soil cannot achieve the required compaction following adequate efforts to moisture condition the soil, over-excavate to undisturbed, firm soil. Over-excavation for convenience shall be at the contractor's expense.
  - Additionally, over-excavations may be required to complete shallow, granular soil improvements below foundations as illustrated in Figure G2.1 on sheet G2, if final design contemplates higher structural loads, different bearing configurations or construction during wet weather. Consult STRATA or the geotechnical engineer-of-record for granular soil improvement depth to achieve higher bearing capacities.
  - Soft soil over-excavation criteria shall be determined during construction with STRATA or the geotechnical engineer-of-record, the contractor, and the lot developer/owner, but is anticipated to extend at least 1.5 to 2 feet below the subgrade.
  - After achieving subgrade, the contractor must take precautions to protect the subgrade from becoming disturbed or saturated. The contractor must limit construction traffic to any prepared subgrades and reduce the subgrades' exposure to precipitation and water.
  - Subgrades must be graded to aggressively direct surface water away from subgrades to avoid infiltration.

**8 STRUCTURAL FILL**

- Material Requirements**
- Structural fill is required to achieve site grades, to help support concrete slabs-on-grade and pavement sections.
  - Site soil should be near or below optimum moisture content and can be relied on for reuse as structural fill in the building footprint, when earthwork is accomplished during dry weather.
  - Our recommended material requirements for structural fill generally reference the latest WSDOT Standards.
  - Embankments constructed during mass grading for Lot 9, Block 2, were placed and compacted per the City of Pullman Earthwork Standards, STRATA's geotechnical report recommendations, and Taylor's grading plan.
  - Project structural fill products are described in Table G2.1 below.

**Table G2.1: Structural Fill Specifications and Allowable Use**

Fill Label	Fill Product Description	Allowable Use	Material Specifications
NSF	Non-Structural Fill (Landscape or Slope Dressing Fill)	<ul style="list-style-type: none"> <li>Any area that will not support pavements, sidewalks, curbs, buildings, or other improvements (typically landscape areas)</li> </ul>	<ul style="list-style-type: none"> <li>Soil classified as GP, GM, GW, GC SP, SM, SW, SC, CL, or ML according to the USCS.</li> <li>Soil may not contain particles larger than 12 inches in median diameter.</li> <li>Soil must be reasonably free from deleterious substances such as wood, metal, plastic, waste, etc.</li> </ul>
SF-1	General Structural Fill	<ul style="list-style-type: none"> <li>Fill placement within building, pavement and hardscapes envelopes, including utility trench backfill</li> <li>Non-structural fill</li> </ul>	<ul style="list-style-type: none"> <li>Soil classified as GP, GM, GW, GC SP, SM, SW, CL, or ML according to the USCS.</li> <li>Soil may not contain particles larger than 6 inches in median diameter.</li> <li>Soil must contain less than 3 percent (by weight) of organics, vegetation, wood, metal, plastic, or other deleterious substances.</li> </ul>
SF-2	Granular Structural Fill (Structural areas)	<ul style="list-style-type: none"> <li>General structural fill</li> <li>Fill placement, construction entrances, and earthwork during wet weather</li> <li>Over-excavations</li> </ul>	<ul style="list-style-type: none"> <li>Soil meeting requirements stated in Section 9-03.14(2) – <i>Select Borrow</i> of WSDOT Standards.</li> </ul>
CS-1	Crushed Surfacing Top Course	<ul style="list-style-type: none"> <li>Granular structural fill</li> <li>General structural fill</li> <li>Concrete slab-on-grade, pavement, and foundation support</li> </ul>	<ul style="list-style-type: none"> <li>Soil meeting requirements stated in Section 9-03.9(3) – <i>Crushed Surfacing</i> of WSDOT Standards.</li> </ul>
DA-1	Drainage Aggregate	<ul style="list-style-type: none"> <li>Drain trench fill</li> </ul>	<ul style="list-style-type: none"> <li>Soil meeting requirements stated in Section 9-03.12(4) – <i>Gravel Backfill Drains</i> of WSDOT Standards<sup>1</sup>.</li> </ul>
PB	Pipe Bedding	<ul style="list-style-type: none"> <li>Utility pipe bedding within 6 inches of the pipe invert</li> </ul>	<ul style="list-style-type: none"> <li>Soil meeting requirements stated in Section 9-03.12(3) – <i>Gravel Backfill for Pipe Zone Bedding</i> of WSDOT Standards.</li> </ul>
-	Unsatisfactory Soil	NONE	<ul style="list-style-type: none"> <li>Soil classified as MH, OH, CH, OL, or PT <b>may not</b> be used at the project site.</li> <li>Any soil type not maintaining moisture contents within 5 percent of optimum during compaction is unsatisfactory soil which must be moisture conditioned prior to disposal and replacement.</li> <li>Any soil containing more than 3 percent (by weight) of organics, vegetation, wood, metal, plastic or other deleterious substances.</li> </ul>

Table G2.1 Notes:  
 1. WSDOT Standard Specification for Road, Bridge and Municipal Construction, 2012 (WSDOT Standards)

**Required Compaction**  
 Backfill supporting any structure, hardscape, embankment, foundation, or other improvement must be compacted to structural fill requirements presented in Table G2.2 below.

**Table G2.2: Required Structural Fill Products for Designated Project Areas**

Project Area	Required Structural Fill Product	Compaction Requirement <sup>1</sup>
In-situ native subgrades	Native soil <sup>2</sup>	Undisturbed (pocket pen > 2 tsf)
Within 10 lateral and 3 vertical feet of building or hardscape footprints or fill placed on/in slopes	General, Granular, and Crushed Surfacing Structural Fill	95% <sup>3</sup>
Utility trench backfill below slabs, pavements, and buildings	Utility Trench Fill	95%
All other fills (more than 10 feet outside or 3 feet below the building or hardscape footprints)	General Structural Fill	92%
Landscape areas sloped flatter than 5H:1V	Topsoil	88%

Table G2.2 Notes:  
 1. Relative compaction requirement compared to the maximum dry density of the soil as determined by ASTM D 1557 (Modified Proctor).  
 2. Native soil must be verified by STRATA or the project geotechnical engineer-of-record.  
 3. Some granular structural fill products require method compaction efforts (reference Oversized Soil fill).

- Fill placed outside any building or pavement envelope (plus 10 feet) can be placed as non-structural fill (i.e. landscape fill) providing there are no structures (sidewalk, curbs, utilities, signs, etc.) or embankment planned directly above the landscape fill. Landscape fill compaction requirements also apply to stemwall backfill that does not support overlying structures such as asphalt, slabs or other improvements free of structures.
- Structural fill products must be moisture conditioned to near optimum moisture content and placed in maximum 10-inch-thick, loose lifts.
- Structural fill shall be compacted in 10-inch-thick, loose lifts providing compaction equipment weighs a minimum of 5 tons. If smaller or lighter compaction equipment is provided, reduce the lift thickness to meet the compaction requirements presented herein.
- The site soil is expected to be suitable for reuse as general structural fill providing it can meet the criteria presented in Table G2.1 above and earthwork is attempted during warm, dry weather.
- Perform compaction testing on each lift, every 1,000 s.f. or every 50 feet along trenches.

**8 STRUCTURAL FILL**

- Oversize Soil Fill**
- Any material with greater than 30 percent retained above the 3/4-inch sieve is too coarse for Proctor density testing, but may be used as general structural fill. Coarse fill must be compacted using a "method specification" developed during construction that is based on the material characteristics and the contractor's means and methods.
  - Separate oversize fill from fine grained subgrades using geosynthetics, see Table G2.3.
  - Method specifications will be developed during construction, specific to the materials, compaction equipment and conditions encountered.
  - At a minimum, place all oversize material in maximum 18-inch lifts and compact with 5 complete passes of a 10-ton, vibratory or grid roller.
  - Vibratory rollers must have a dynamic force of at least 30,000 pounds per impact per vibration and at least 1,000 vibrations per minute. Coarse fill must be compacted to a dense, interlocking and unyielding surface.
- Utility Trench Backfill**
- Remove all saturated, loose or disturbed soil from the bottom of the utility trenches prior to placing pipe bedding.
  - Accomplish bedding for pipes and utility trenches in accordance with Division 7 of the latest edition of the *WSDOT Standard*.
  - Backfill the remainder of utility trenches in accordance with the *Structural Fill* specification.

**9 GEOSYNTHETICS**

Geosynthetic uses and material requirements are provided in Table G2.3.

**Table G2.3: Geosynthetic Specifications**

Geosynthetic Type	Use	Material Specifications
Non-Woven Geosynthetic	Pavement subgrade preparations, footing soil improvements	<ul style="list-style-type: none"> <li>Must meet <i>Soil Stabilization – Non-Woven</i> requirements in <i>WSDOT Standards</i> Section 9-33.2(1), Table 3.</li> </ul>
Triaxial or Biaxial Geogrid	Extremely soft subgrade conditions	<ul style="list-style-type: none"> <li>93 percent junction efficiency (GRI-GG2-05)</li> <li>3.0 kg-cm/degree Aperture Stability (U.S. Army Corp of Engineers Ref. 3.3.1.2000)</li> <li>Extruded polypropylene</li> <li>Minimum Radial Stiffness of 15,400 lb/ft at 0.5% Strain (ASTM D6637)</li> </ul>

- Geosynthetics**
- Geosynthetic fabrics are applicable when constructing on soft or wet soil, for soil improvement applications, or any area where *Oversize Soil Fill* must be separated from the fine-grained subgrade.
  - Where required for foundation support, to aid construction or increase long-term performance, apply geosynthetics directly on approved subgrades, taut, free of wrinkles and over-lapped at least 12 inches.
  - Consult STRATA to review geosynthetic applications or other subgrade improvement alternatives.
  - We recommend woven geosynthetic fabrics conform to Section 9-33 - *Construction Geosynthetic* and specifically meet or exceed the properties presented in Table 3, Section 9-33.2(1) - *Geotextile Properties* from WSDOT Standards.
  - Geogrid is not expected to be required unless extremely soft subgrades develop during construction due to unusually high groundwater or construction during wet seasons. However, project specifications should delineate requirements for geogrid in extremely soft subgrade conditions and require the contractor to supply a unit rate if they are required, as shown in Table G2.3.

**10 SITE DRAINAGE**

- Foundations/Walls**
- Place interior fill around stemwalls as granular structural fill to within 8 inches of the finish grade. Then place crushed surfacing within the last 8 inches beneath finish grade.
  - Place exterior stemwall backfill as drainage aggregate as shown of Figure G3.1.
  - Install perimeter foundation drains at the lowest possible elevation that maintains gravity drainage as shown on Figure G3.1.
  - Divert stormwater to an appropriate disposal system specified by Civil Engineering.

- Exterior Grading**
- Site grading design and construction must allow for positive drainage of surface runoff water away from the proposed structure and not be allowed to infiltrate foundation and slab subgrades.
  - Runoff or water migrating along the ground surface must be conveyed away from structures by an appropriately designed series of ditches, swales, or other surface water management procedures by the Civil Engineer.
  - Per IBC Section 1804.3, slope all surfaces within 10 feet of the structure away at 5 percent except where ADA requirements must be met. Where IBC standards cannot be met, slope ground as aggressively as possible to direct water away from the building's perimeter.
  - Slope the remaining sidewalks and paved surfaces at least 2 percent away from the structures. This reduces the risk of subsurface soil near the foundation becoming saturated due to water ponding near the structure.
  - Provide and connect roof downspouts to a solid pipe placed away from structures and do not allow water to infiltrate into the soil underlying the structure. Never connect roof drain to foundation drainpipes.
  - Avoid landscaping which requires irrigation adjacent to or within 10 feet of the building.

- Stormwater Disposal**
- Washington State Department of Ecology (WDOE) requires site specific stormwater discharge permits for any construction site disturbing more than 1 acre.
  - Divert stormwater to an appropriate disposal system specified by site Civil Design.
  - Connect to the Palouse Business Center's stormwater system per development covenants.
  - Design stormwater lot specific disposal facilities in accordance with the *WDOE Eastern Regional Stormwater Management* manual and the City of Pullman requirements. Specifically, avoid depositing stormwater into the subsurface in a manner that will impact down slope or adjacent properties.
  - The soil profile encountered in explorations was classified as clay and has low permeability and no capacity for vertical stormwater infiltration. Based on gradation results and previous exploration in the area, USDA classifications correlate to clay at depth.
  - Stormwater may be treated in grassed lined, bio-infiltration swales, but swales must be sufficiently sized to store water and rapidly convey it to the on-site stormwater detention facility, ultimately to be extended out to the City of Pullman, Stormwater system.
  - Direct collected stormwater at least 50 feet away from structures.
  - If Civil Design or other issues will not allow appropriate collection and disposal points set away from structures the minimum distance recommended above, the design team must evaluate alternate stormwater disposal plans.
  - Providing regular site stormwater inspections during construction by a *Certified Erosion Control Sediment Lead* (CESL) is required by WDOE for SWPPP implementation.

- ISSUED FOR**
- PRELIMINARY DESIGN USE
  - PRELIMINARY REVIEW
  - YOUR APPROVAL
  - REFERENCE
  - CONSTRUCTION
  - DESTROY PREVIOUS PRINTS

REV	DATE	DESCRIPTION
1	1/10/14	DRAFT 90%
2	1/13/14	FINAL DESIGN
		KIP REVIEWED

DRAWN: CWS

DESIGN: TJW

CHECK: TJW

FILE: KIPDEV PU12186C

PROJECT:  
 PALOUSE BUSINESS CENTER  
 LOT 9 BLOCK 2  
 GRANDE RONDE COURT  
 PULLMAN, WASHINGTON 99163

PREPARED FOR:  
 KIP DEVELOPMENT  
 594 SOUTHEAST BISHOP  
 BOULEVARD #102  
 PULLMAN, WASHINGTON 99163  
  
 Attn: MR. KEVIN KIRKMAN



ENGINEER STAMP



6 O'Donnell Road,  
 Pullman, Washington 99163  
 Phone #: (509) 339-2000  
 Fax #: (509) 339-2001  
 www.stratageotech.com


**FOUNDATION DESIGN**

The Lot 9 Block 2 structures and site configuration concepts are assumed. Based on the site conditions, exploration and testing performed to date and our assumptions regarding development plans, we expect the Lot developments will interface with native soil and structural fill. Providing the site soil remains protected from weather and infiltration, it is generally suitable for conventional foundation bearing. If foundations are constructed during wet weather or if wet soil conditions are exposed, it may be necessary to construct granular soil improvements beneath foundations as shown below. Consult STRATA or the geotechnical engineer-of-record for granular soil improvement depths to achieve the design requirements.


**Granular Soil Improvement Construction**

Where foundations are constructed during wet soil conditions or if final structural and geotechnical design dictate, construct granular soil improvements according to the following steps:

1. Over-excavate soil below the planned foundation bearing elevation and expose stiff (pocket pen >2 tsf) site soil, previously compacted or undisturbed. Excavation depth will be determined by final design.
2. Prepare the exposed subgrade referencing the *Earthwork* requirements using smooth-blade equipment.
3. Place non-woven geosynthetic fabric over the subgrade and extend it up the sidewalls to the bearing elevation. Non-woven geosynthetic fabric must meet the requirements in Table G2.3.
4. Backfill over-excavations with crushed surfacing placed and compacted referencing Table G2.1 and the *Structural Fill* section.
5. Schematics illustrating the soil improvement process are provided in Figures G3.1 and G3.2, *Granular Soil Improvement*. Foundation stem wall height may vary. Figures G3.1 and G3.2 are not structural details.

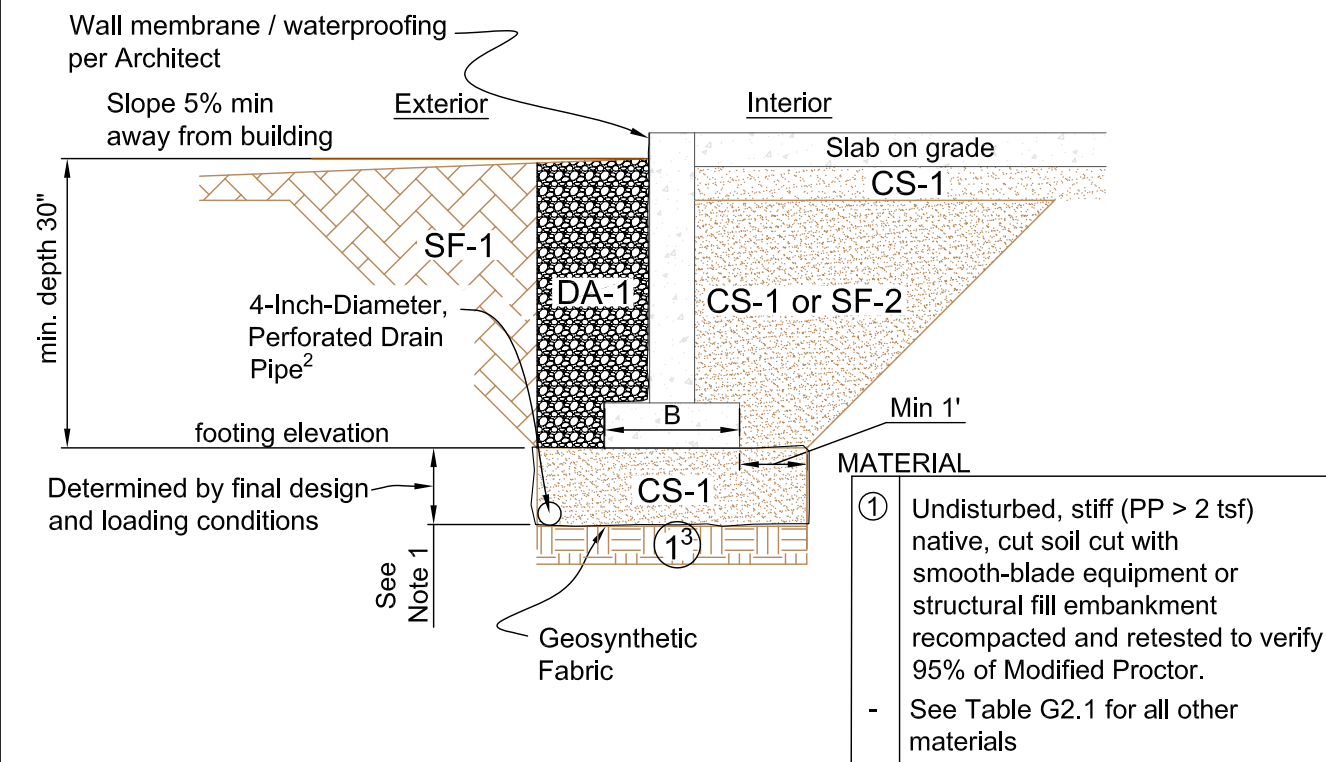

**Figure G3.1: Soil Improvement Schematic - Continuous Perimeter Foundations**

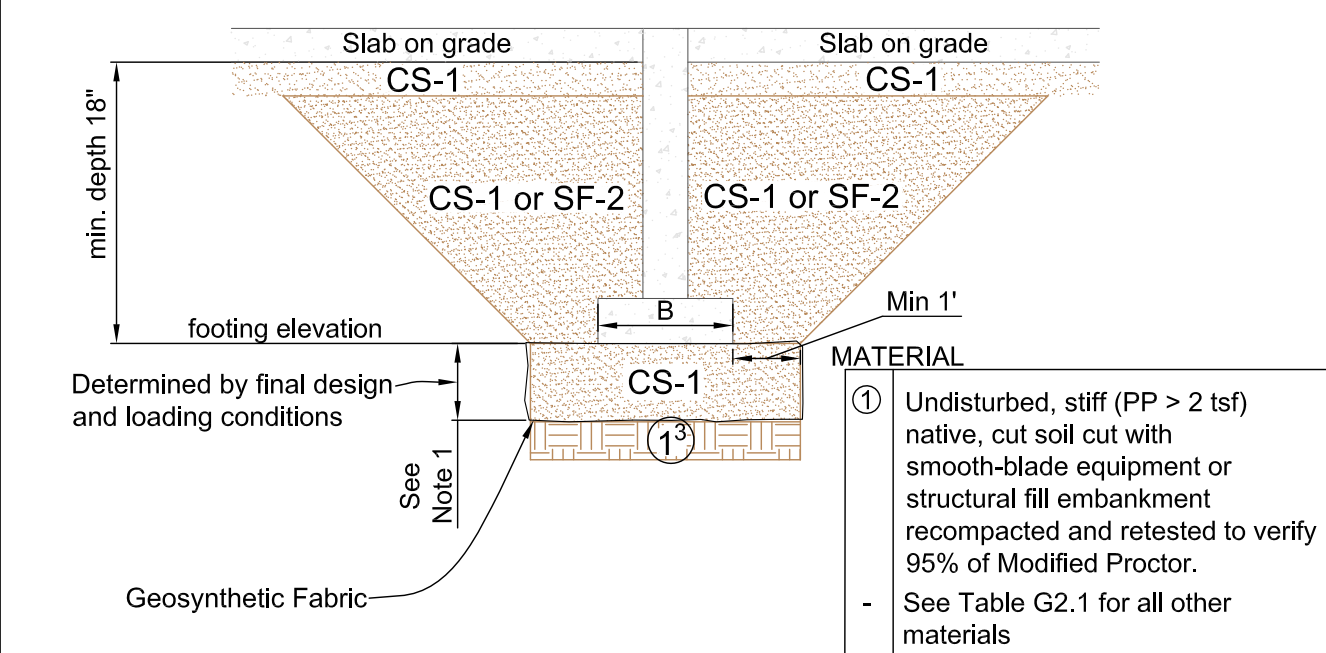

**Figure G3.2: Soil Improvement Schematic - Column Foundations (Interior)**

- Notes:
1. Extend soil improvement below isolated column and continuous perimeter foundations as required by final structural and geotechnical design or to assist construction during wet weather.
  2. Adjust foundation drain pipe elevation depending on soil improvement applications. Foundation drain shall never be placed above the foundation bearing elevation.
  3. Where structural embankment (see Lot Plan, sheet G4) is exposed at foundations and verified by the project geotechnical engineer, recompact to 95% of Modified Proctor.

The following foundation design parameters are stated for total loads referenced on Sheet G1, and are based on bearing foundations on undisturbed stiff native soil, soil recompacted to structural fill requirements, or if required, granular soil improvements as described above. From mass grading in 2013, the foundation substrate soil is expected to be structural fill mantling stiff clay/silt loess or stiff clay loess. Structural fill has been placed and compacted to between 92 and 95 percent of ASTM D1557 (Modified Proctor). City of Pullman and geotechnical design requirements are that foundation and slab substrates be compacted to at least 95 percent of Modified Proctor. Some subgrade moisture conditioning and recompaction should be anticipated. From geotechnical field and laboratory testing, and engineering analyses, preliminary design shallow foundations using the following criteria:

1. Maximum allowable bearing pressure: 2,000 psf, undisturbed stiff native soil or structural fill
  - Maximum 33 percent increase allowed for short term load increases such as wind or seismic.
  - Higher design bearing pressures are possible depending on settlement tolerances or the application of granular soil improvement. Consult STRATA or the geotechnical engineer-of-record for applicable bearing pressure for your project.
2. Estimated foundation/slab vertical settlement from assumed structural loads:
  - Total settlement: 1.0 inch
  - Differential settlement: Up to 0.75 inches in 30-foot horizontal span
3. Embankment settlement:
  - Less than 10 feet in height: 0.5% of embankment height = 0.6 inches
  - **Embankment settlement will occur over 1 to 2 years and is in addition to foundation settlement**
4. Lateral load resistance:
  - Foundation base friction coefficient:
    - 0.30 for foundations cast directly on site soil bearing surface
    - Reduce friction coefficient by 1/3 for precast concrete
  - Passive soil resistance on foundation sides:
    - Equivalent fluid pressure: 250 pcf
    - Requires 1/2-inch lateral movement to mobilize full resistance
4. Extend exterior footings at least 30 inches below the final, exterior ground surface to help protect against frost action.
5. Bear interior foundations at least 18 inches below finish slab elevations and maintain at least 4 inches of soil cover between top of the footing and the bottom of the concrete slab. Thickened footings should be avoided due to their propensity for reflective cracking.
6. STRATA or the retained geotechnical engineer-of-record shall observe foundation soil improvement, bearing, and slab subgrades. Reviewing the subgrade during site and foundation preparation allows verification that vegetation, organics, and significant debris have been removed to the required elevation and that excavations have been accomplished according to these recommendations.
7. The above design criteria require maintaining drained conditions at the foundation subgrade.

**Soil Corrosivity**

1. Corrosion of buried metallic structures is an electrochemical process and is dependent on many factors, including type of metal or alloy, galvanic effects, and soil properties such as resistivity, pH and oxygen content. Generally, soil that has low resistivity and low pH is more corrosive than soil with high resistivity and high pH.
2. Experience with the site soil and aggregate in the Pullman area suggests these materials maintain a relatively neutral pH and moderate to low resistivity indicating a heavy to potentially severe corrosion potential.
3. Consider steel loss due to corrosion with respect to selecting pipes and other buried or underground structures.
4. Maintain maximum clearances for concrete reinforcing.

**Seismic Activity Research**


1. We expect the 2012 *International Building Code (IBC)* will be utilized for project structural design. Section 1613 of the IBC outlines the procedure for evaluating site ground motions and design spectral response accelerations.
2. STRATA utilized site soil and geologic data and the project location to establish earthquake-loading criteria.
3. Based on our field exploration, mapping in the area, bedrock exposures nearby, and knowledge of the upper 100 feet of soil/rock profile, we recommend a Site Class D be utilized as a basis for structural seismic design.
4. A site-specific seismic response study was not performed.
5. Liquefaction is common in loose and saturated sand. The liquefaction potential decreases when the soil profile density increases and the percentage of fine-grained soil increases. The soil beneath the planned improvements comprises firm to stiff clay soil, overlying basalt bedrock at depth. Groundwater is not expected within the upper 20 feet beneath the planned surface grades. However, due to the stiff, fine-grained soil expected beneath the site, the potential for liquefaction during a seismic event at this site appears low.

**CONCRETE SLAB-ON-GRADE FLOORS**

**Slab Substrate**

1. Place crushed surfacing structural fill, as defined in Table G2.1 on sheet G2, over stiff recompacted site soil as described in the *Earthwork* section. Compact slab subgrades to at least 95 percent of Modified Proctor.
2. Subgrade areas that become soft, wet or disturbed during slab subgrade preparations must be moisture conditioned and recompacted, or over-excavated to stiff soil (PP > 2 tsf) and replaced with crushed surfacing.
3. Compact crushed surfacing below slabs to structural fill requirements as defined in Table G2.2, sheet G2.
4. The slab's supporting aggregate course must be constructed once the majority of underslab plumbing and utilities are completed.
5. Floor and exterior slabs and supporting crushed surfacing section thicknesses must be structurally designed for the anticipated use and equipment or storage loading conditions.
6. Concrete slab design may utilize an allowable modulus of subgrade reaction (k) of 140 pounds per cubic inch (pci) (Figure G3.4) for slab sections constructed over compacted, site soil and at least 8-inches of crushed surfacing for slab support and as a capillary break. Structural design will designate crushed surfacing thickness.


Figure G3.4, *Floor Slab Schematic* illustrates a concrete slab-on-grade floor. Figure G3.4 is a not structural detail.

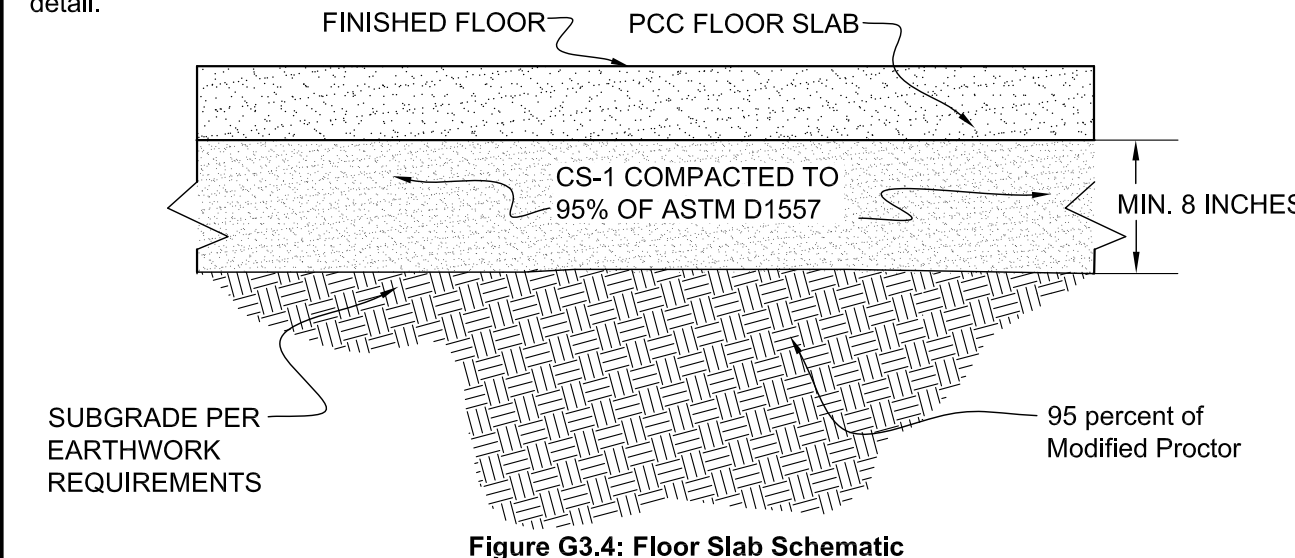

**Figure G3.4: Floor Slab Schematic**

**Vapor Retarder**

1. Interior floor slabs may be susceptible to moisture migration caused by subsurface capillary action and vapor pressure. Moisture migration through floor slabs can break down a floor covering, its adhesive, or cause various other floor covering performance problems.
2. Vapor retarders shall consist of thick, puncture proof polyethylene sheeting placed immediately below the floor slab. An example of this material is Stego Wrap™, a 15-mil retarder.
3. Alternatively, the vapor retarder may be covered with an additional 2-inch-thick layer of clean, coarse sand placed between the aggregate base course and the concrete slab-on-grade floors, if the base material and slabs are placed with a water proof roofing system in-place (See Figure G3.5 below).
4. Form stakes or other sub-slab penetrations must never be allowed to puncture the vapor retarder.
5. Plumbing penetrations and foundation edges are notoriously problematic for under-slab vapor protection.
6. Carefully design and construct any vapor retarder penetrations to reduce vapor transport through any penetrations.
7. Even when vapor retarders are used, water vapor migration through the concrete floor slab is still possible.
8. Floor covering should be selected accordingly. Manufacturer's recommendations shall be followed.
9. Where vapor retarders are utilized, the flooring and concrete slab contractors as well as the plastic sheeting manufacturer must be consulted regarding additional slab cure time requirements and/or the potential for slab curling.

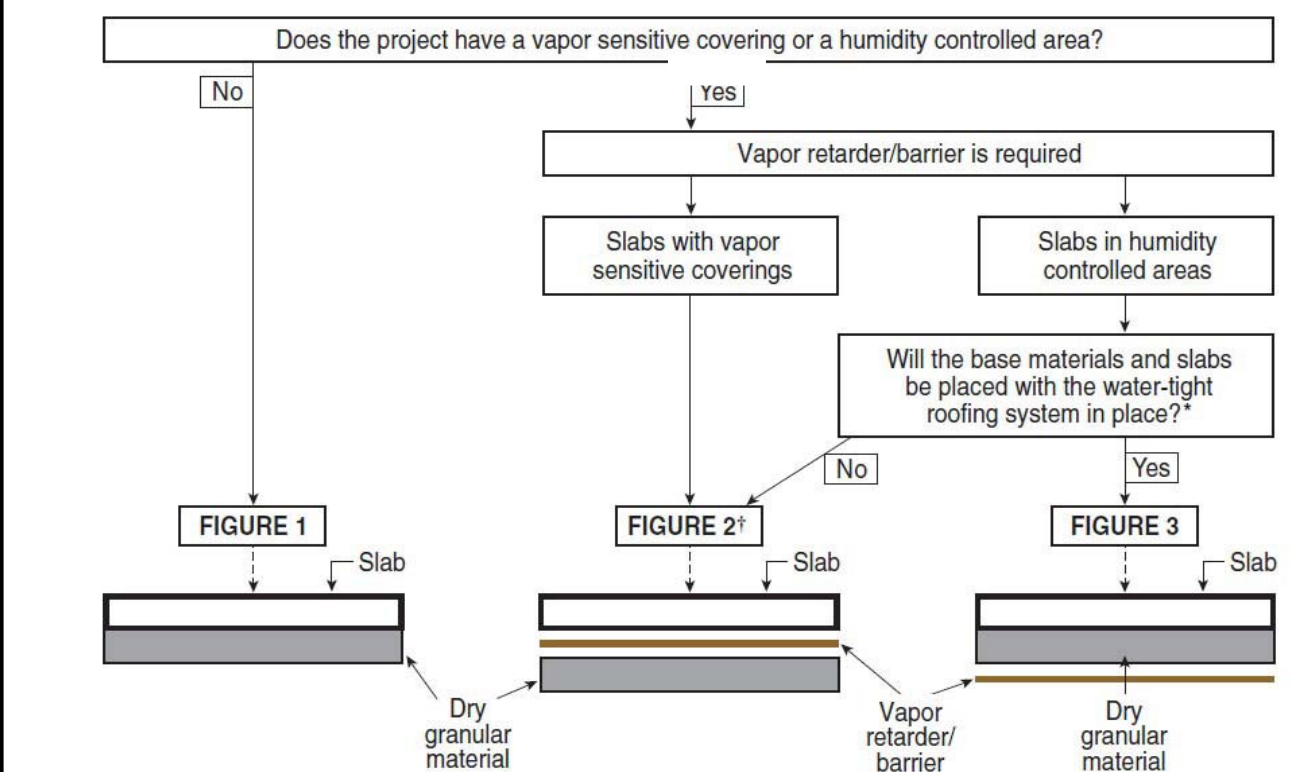

NOTE: \* If granular material is subject to future moisture infiltration, use Figure 2  
 † If Figure 2 is used, a reduced joint spacing, a low shrinkage mix design, or other measures to minimize slab curl will likely be required

**Figure G3.5. Flowchart to determine how vapor retarder should be installed (adapted from Figure 3-1 of ACI 302.1R-04)**

**Exterior Slab Considerations**

**General**

1. Portland Cement Concrete (PCC) for exterior pavements and slabs shall meet WSDOT Standards and have a minimum 4,000 psi compressive strength (per City of Pullman Requirements), 650 psi modulus of rupture, and 4 to 7 percent entrained air.
2. Per Structural Design Specifications, apply curing compounds on all exterior concrete surfaces. Due not apply salts or salt solutions to the hardscape surfaces.
3. Sawcut the concrete per Structural Design and Landscape Architect pattern as soon as possible following placement to reduce the potential for shrinkage cracking.
4. Joint and cure exterior concrete referencing ACI and Landscape Architect requirements to help reduce random cracking, shrinkage cracking, and to facilitate construction and concrete curing.
5. Structurally design joints to occur through contraction joints, construction joints, and isolation joints, accounting for the concrete surface geometry and paving plan.
6. Joint details, fixture details, sealant details, and other appropriate design and construction practices are illustrated in the ACI 330R-08 document and should be incorporated into project plans.
7. For dumpster's or other equipment pads, construct the slab support section with a minimum of 18 inches of crushed surfacing.

**Frost Considerations**

1. Frost jacking/frost heave are rigid pavement/hardscape design concerns, particularly where abrupt changes in soil frost susceptibility occur.
2. Abrupt changes occur where rigid pavements/hardscapes meet flexible pavements or at building entrances and foundations. Soil subgrades will exist in areas where exterior slabs are planned and about the building.
3. To accommodate these locations and reduce the frost action potential, excavate 2/3 of the frost depth (20 inches), extending 10 lateral feet from the building or at any trash enclosure or accept the risks of frost action.
4. Replace these over-excavations with granular structural fill or crushed surfacing.
5. Consult the Structural Engineer regarding additional measures to help resist frost action.

- ISSUED FOR**
- PRELIMINARY DESIGN USE
  - PRELIMINARY REVIEW
  - YOUR APPROVAL
  - REFERENCE
  - CONSTRUCTION
  - DESTROY PREVIOUS PRINTS

REV	DATE	DESCRIPTION
1	1/10/14	DRAFT 90%
2	1/13/14	FINAL DESIGN
		KIP REVIEWED

DRAWN: CWS

DESIGN: TJW

CHECK: TJW

FILE: KIPDEV PU12186C

PROJECT:  
 PALOUSE BUSINESS CENTER  
 LOT 9 BLOCK 2  
 GRANDE RONDE COURT  
 PULLMAN, WASHINGTON 99163

PREPARED FOR:  
 KIP DEVELOPMENT  
 594 SOUTHEAST BISHOP  
 BOULEVARD #102  
 PULLMAN, WASHINGTON 99163

Attn: MR. KEVIN KIRKMAN




ENGINEER STAMP



6 O'Donnell Road,  
 Pullman, Washington 99163  
 Phone #: (509) 339-2000  
 Fax #: (509) 339-2001  
 www.stratageotech.com

13 LOT PLAN

- Legend**
- TP-33** Approximate test pit location observed by STRATA, December 18 and 19, 2012. Only exploration specific to this Lot are shown.
  - RP-6** Approximate rock probe location observed by STRATA, January 2, 2013. Only exploration specific to this Lot are shown.
  - (2520.93)** Original ground surface elevation ASML (feet) surveyed by Taylor Engineering Inc.
  - Approximate subsurface trench drain pipe location as surveyed by Taylor Engineering Inc.
  - GPS locations of density test conducted to 2013 mass grading Plan and geotechnical requirements using a nuclear densometer. Point numbers shown on this Lot Plan correspond to individual density locations from Daily Field Reports and Density Test Reports transmitted during mass grading and infrastructure construction in 2013. Density value results are maintained in STRATA's records and are available upon request.
  - Approximate mass grading cut regions of the site. Remaining site grades established in structural fill.
  - Approximate temporary surface drain installed to route stormwater runoff to temporary catchment basin. Permanent measures will be designed when lot development occurs.

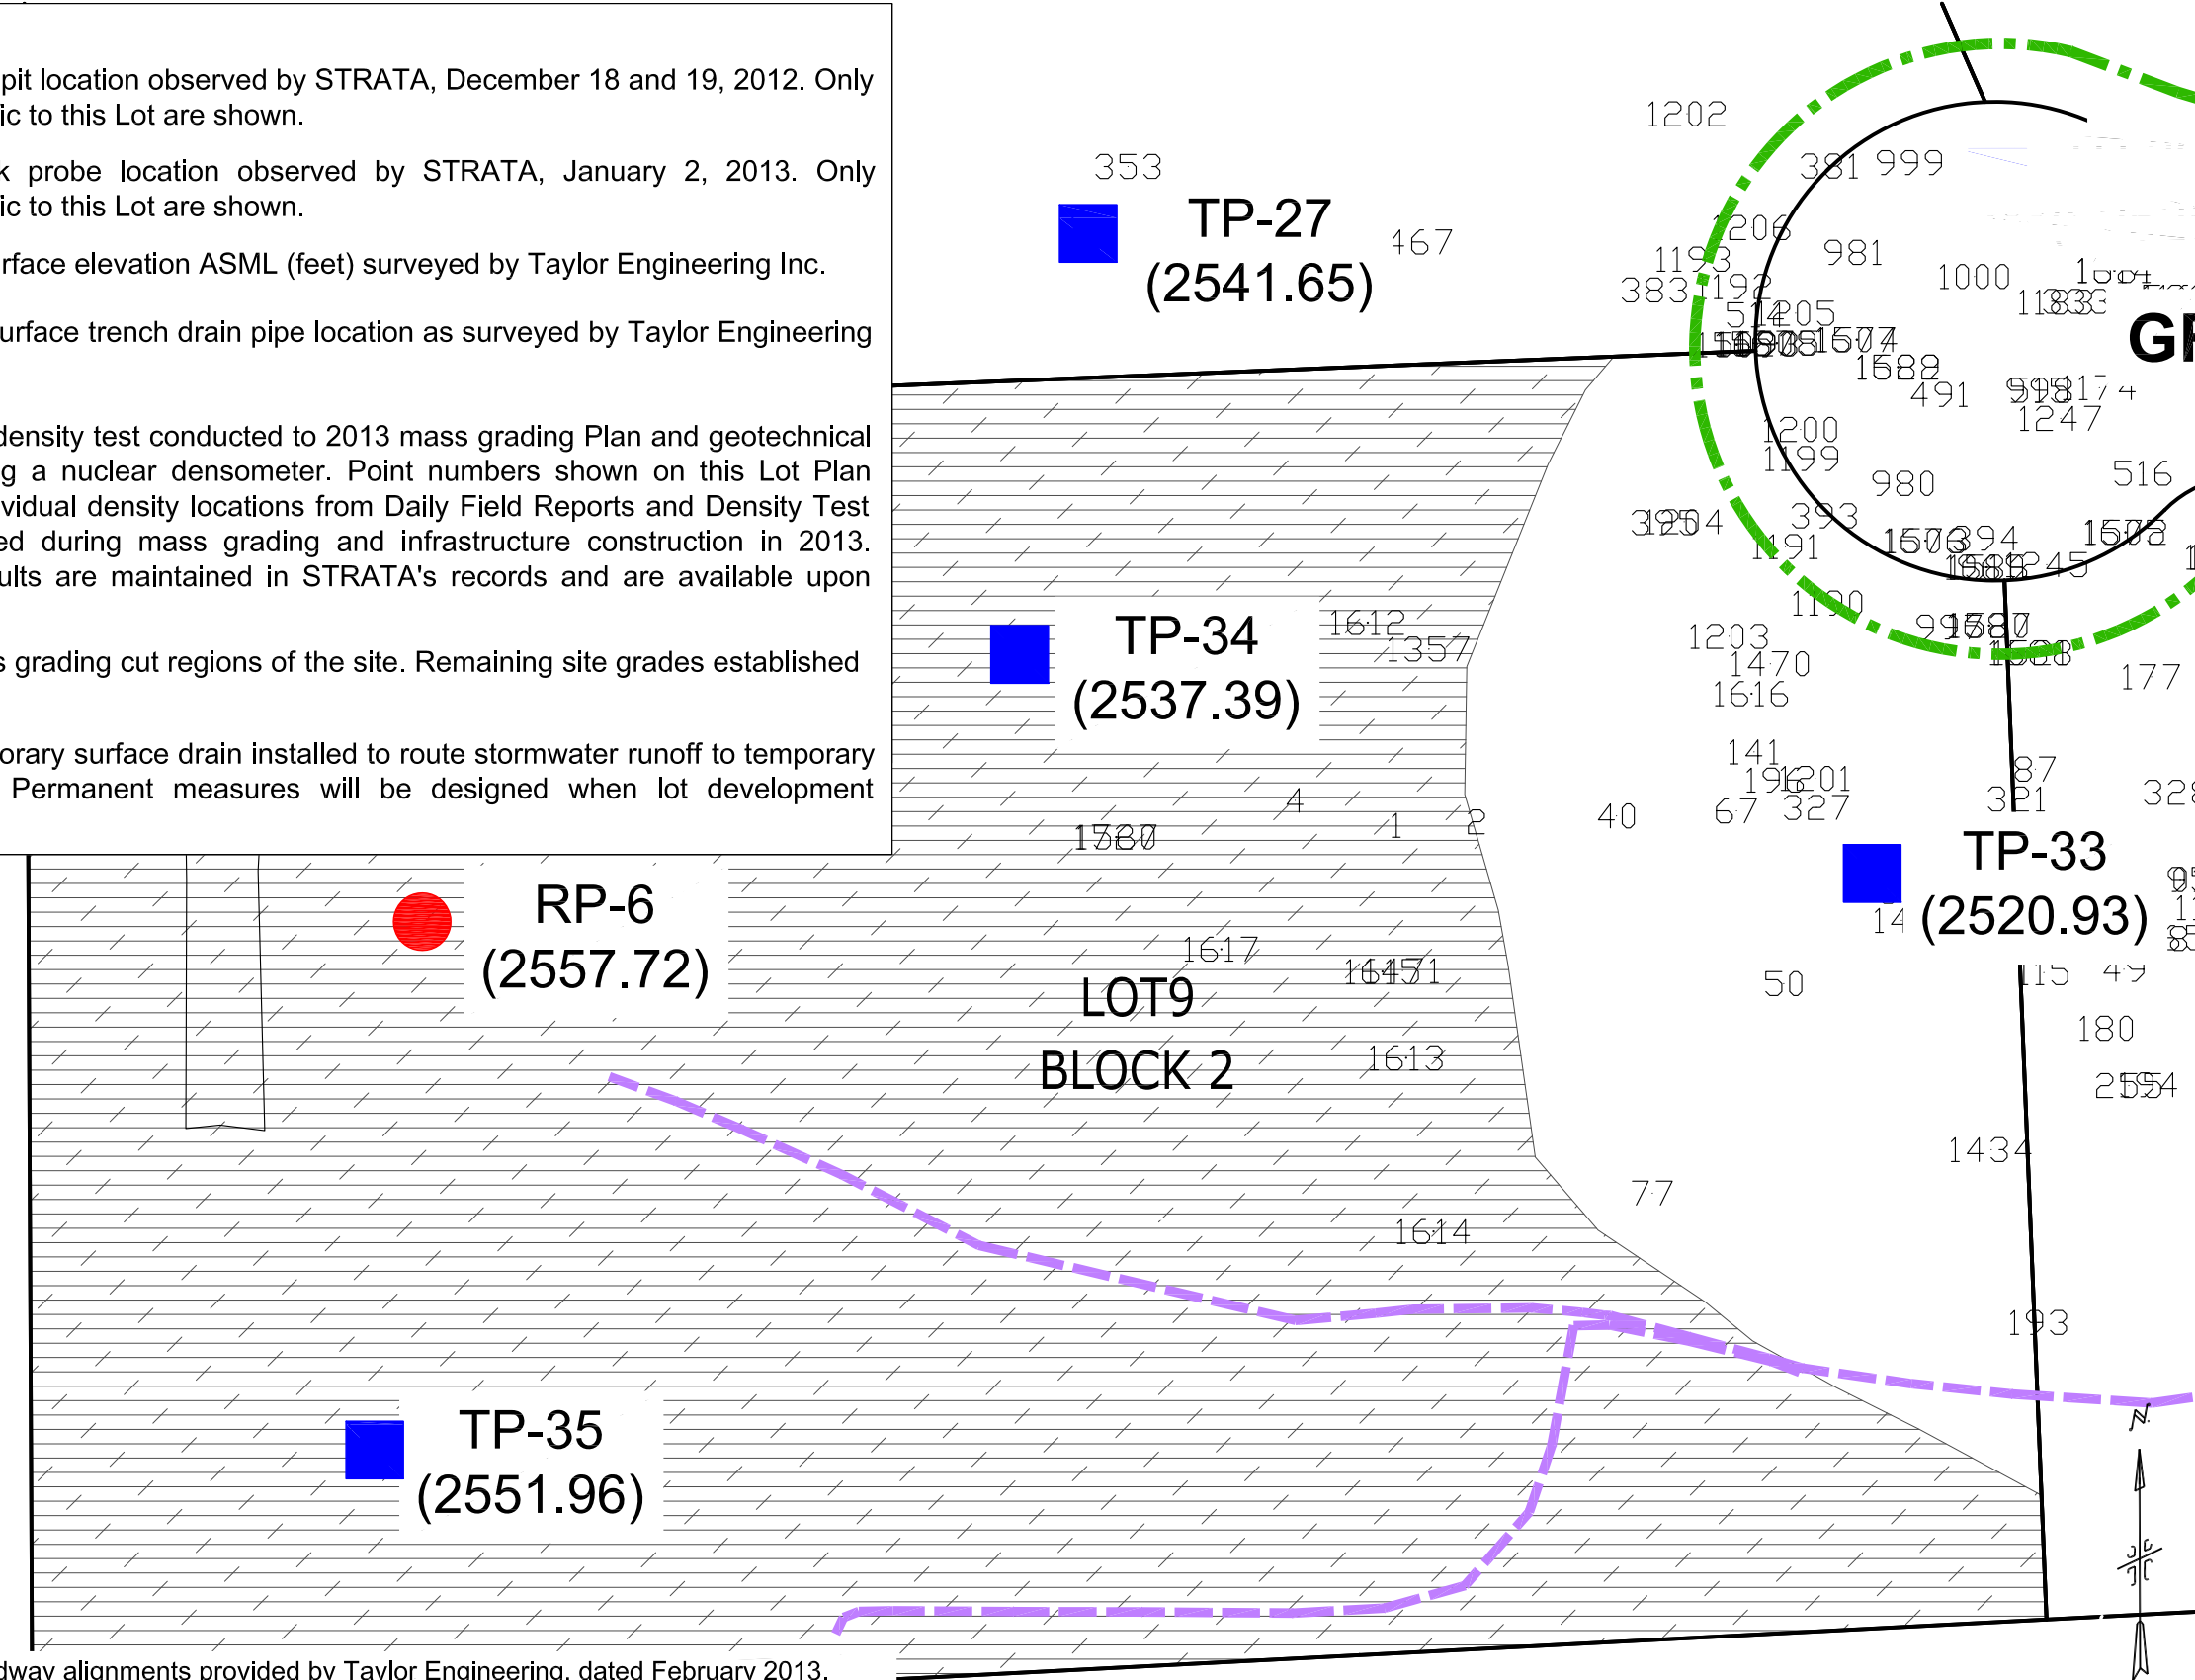

Reference: Lot boundaries and roadway alignments provided by Taylor Engineering, dated February 2013. Exploration locations and their elevations surveyed by Taylor Engineering.

NOT TO SCALE

14 EXPLORATION LOGS

USCS Description	DEPTH (ft)	U.S.C.S. CLASS	SYMBOL	Sample Type	USDA SOIL Textural Classification No. 200 Sieve	Dry Density (pcf)	Moisture Content (%)	Pocket Pen. (tsf)	REMARKS
TOPSOIL - SILT, (ML) dark brown, soft, moist	0.0	ML							Vegetation and organics observed to 12" BGS
ALLUVIUM - CLAY, (CL) reddish brown with gray mottling, very stiff, moist to wet	0.0 - 2.5	CL							
LOESS - CLAY, (CL) reddish brown, very stiff, moist	2.5 - 11.0	CL				108.4	11.6	2.0-3.0	
Test Pit Terminated at 11.0 Feet. Scops observed. Loosely backfilled with site cuttings upon completion.									
Elevation 2520.93 AMSL (feet) Lot 9									
Client: KIPDEV		Test Pit Number: TP-33		STRATA		EXPLORATORY TEST PIT LOG			
Project: PU12186A		Date Excavated: 12-18-2012		A PROFESSIONAL SERVICES CORPORATION		Sheet 1 Of 1			
Backhoe: HITACHI EX120		Bucket Width: 30		Integrity From the Ground Up					
Depth to Groundwater: N.E.		Logged By: CWS							

USCS Description	DEPTH (ft)	U.S.C.S. CLASS	SYMBOL	Sample Type	USDA SOIL Textural Classification No. 200 Sieve	Dry Density (pcf)	Moisture Content (%)	Pocket Pen. (tsf)	REMARKS
TOPSOIL - SILT, (ML) dark brown, soft, moist	0.0	ML							Vegetation and organics observed to 10" BGS
LOESS - CLAY, (CL) reddish brown, very stiff, moist	0.0 - 10.0	CL							
Test Pit Terminated at 10.0 Feet. Loosely backfilled with site cuttings upon completion.									
Elevation 2551.96 AMSL (feet) Lot 9									
Client: KIPDEV		Test Pit Number: TP-35		STRATA		EXPLORATORY TEST PIT LOG			
Project: PU12186A		Date Excavated: 12-18-2012		A PROFESSIONAL SERVICES CORPORATION		Sheet 1 Of 1			
Backhoe: HITACHI EX120		Bucket Width: 30		Integrity From the Ground Up					
Depth to Groundwater: N.E.		Logged By: CWS							

14 EXPLORATION LOGS

UNIFIED SOIL CLASSIFICATION SYSTEM			
MAJOR DIVISIONS	GRAPH SYMBOL	LETTER SYMBOL	TYPICAL NAMES
COARSE GRAINED SOIL	GRAVEL	CLEAN GRAVEL	GW Well-Graded Gravel, Gravel-Sand Mixtures.
		GRAVEL WITH FINES	GP Poorly-Graded Gravel, Gravel-Sand Mixtures.
		GRAVEL WITH FINES	GM Silty Gravel, Gravel-Sand-Silt Mixtures.
	SAND	CLEAN SAND	SW Well-Graded Sand, Gravelly Sand.
		SAND WITH FINES	SP Poorly-Graded Sand, Gravelly Sand.
		SAND WITH FINES	SM Silty Sand, Sand-Silt Mixtures.
FINE GRAINED SOIL	SILT AND CLAY LIQUID LIMIT LESS THAN 50%	ML	Inorganic Silt, Sandy or Clayey Silt.
		CL	Inorganic Clay of Low to Medium Plasticity, Sandy or Silty Clay.
		OL	Organic Silt and Clay of Low Plasticity.
	SILT AND CLAY LIQUID LIMIT GREATER THAN 50%	MH	Inorganic Silt, Micaceous Silt, Plastic Silt.
		CH	Inorganic Clay of High Plasticity, Fat Clay.
		OH	Organic Clay of Medium to High Plasticity.
PT	Peat, Muck and Other Highly Organic Soil		

BORING LOG SYMBOLS	GROUNDWATER SYMBOLS	TEST PIT LOG SYMBOLS
Standard 2-Inch OD Split-Spoon Sample	Groundwater After 24 Hours	BG Baggie Sample
California Modified 3-Inch OD Split-Spoon Sample	(7-3-07) Indicates Date of Reading	BK Bulk Sample
Rock Core	Groundwater at Time of Drilling	RG Ring Sample
Shelby Tube 3-Inch OD Undisturbed Sample		

Shorthand Notation:  
BGS = Below Existing Ground Surface  
N.E. = None Encountered

USCS Description	DEPTH (ft)	U.S.C.S. CLASS	SYMBOL	Sample Type	USDA SOIL Textural Classification No. 200 Sieve	Dry Density (pcf)	Moisture Content (%)	Pocket Pen. (tsf)	REMARKS
TOPSOIL - SILT, (ML) dark brown, soft, moist	0.0	ML							Vegetation and organics observed to 10" BGS
LOESS - CLAY, (CL) reddish brown, very stiff, moist	0.0 - 2.0	CL						2.0	
Test Pit Terminated at 11.0 Feet. Loosely backfilled with site cuttings upon completion.									
Elevation 2541.65 AMSL (feet) Lot 9									
Client: KIPDEV		Test Pit Number: TP-27		STRATA		EXPLORATORY TEST PIT LOG			
Project: PU12186A		Date Excavated: 12-18-2012		A PROFESSIONAL SERVICES CORPORATION		Sheet 1 Of 1			
Backhoe: HITACHI EX120		Bucket Width: 30		Integrity From the Ground Up					
Depth to Groundwater: N.E.		Logged By: CWS							

USCS Description	DEPTH (ft)	U.S.C.S. CLASS	SYMBOL	Sample Type	USDA SOIL Textural Classification No. 200 Sieve	Dry Density (pcf)	Moisture Content (%)	Pocket Pen. (tsf)	REMARKS
TOPSOIL - SILT, (ML) dark brown, soft, moist	0.0	ML							Vegetation and organics observed to 10" BGS
LOESS - CLAY, (CL) reddish brown, very stiff, moist	0.0 - 1.0	CL						1.0	
Test Pit Terminated at 12.0 Feet. Loosely backfilled with site cuttings upon completion.									
Elevation 2537.39 AMSL (feet) Lot 9									
Client: KIPDEV		Test Pit Number: TP-34		STRATA		EXPLORATORY TEST PIT LOG			
Project: PU12186A		Date Excavated: 12-18-2012		A PROFESSIONAL SERVICES CORPORATION		Sheet 1 Of 1			
Backhoe: HITACHI EX120		Bucket Width: 30		Integrity From the Ground Up					
Depth to Groundwater: N.E.		Logged By: CWS							

**Rock Probe Exploration Results**

Rock Probe Location	Existing Surface Elevation (feet) <sup>1</sup>	Basalt Bedrock Elevation Encountered (feet) <sup>2</sup>	Rock Probe Termination Elevation (feet)	Lot Rock Probe was Completed
RP-6	2557.7	2527.7	2521.7	Lot 9, Block 2

1. Elevations provided by Taylor Engineering, Inc.


- ISSUED FOR**
- PRELIMINARY DESIGN USE
  - PRELIMINARY REVIEW
  - YOUR APPROVAL
  - REFERENCE
  - CONSTRUCTION
  - DESTROY PREVIOUS PRINTS

REV	DATE	DESCRIPTION
1	1/10/14	DRAFT 90%
2	1/13/14	FINAL DESIGN
		KIP REVIEWED

DRAWN: CWS  
DESIGN: TJW  
CHECK: TJW

FILE: KIPDEV PU12186C  
PROJECT:  
PALOUSE BUSINESS CENTER  
LOT 9 BLOCK 2  
GRANDE RONDE COURT  
PULLMAN, WASHINGTON 99163

PREPARED FOR:  
KIP DEVELOPMENT  
594 SOUTHEAST BISHOP  
BOULEVARD #102  
PULLMAN, WASHINGTON 99163  
Attn: MR. KEVIN KIRKMAN

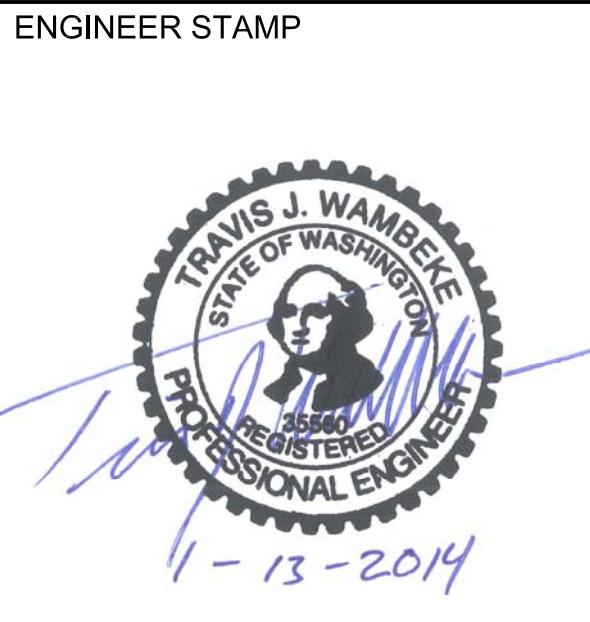

6 O'Donnell Road,  
Pullman, Washington 99163  
Phone #: (509) 339-2000  
Fax #: (509) 339-2001  
www.stratageotech.com

**15 LABORATORY RESULTS**


Index Laboratory Test Results Summary

Boring	Depth (feet)	Lab Number	Description and remarks (classification)	Liquid Limit	Plasticity Index	In situ Moisture, %	In situ Dry Density, pcf	Passing No. 200, %	Soluble Sulfates (mg/kg)	pH	Resistivity (ohms-cm)
TP-33	3.5-4	PUL12-224G	Clay (CL)	-	-	11.6	108.4	-	-	-	-
TP-34	7-8	PUL12-224E	Clay (CL)	-	-	-	-	93.5	-	-	-

**GRADATION ANALYSIS**  
ASTM D422

Project: Pullman Hospital Commercial Development  
 Client: KIP Development  
 File: KIPDEV - PU12186A  
 Sample No: PUL12-224E  
 Sample Location: TP-34 @ 7-8 feet BGS  
 Description: Clay (CL)  
 Date tested: 12/28/2012

Cobbles	Gravel		Sand			Fines	
	Coarse	Fine	Coarse	Medium	Fine	Silt	Clay

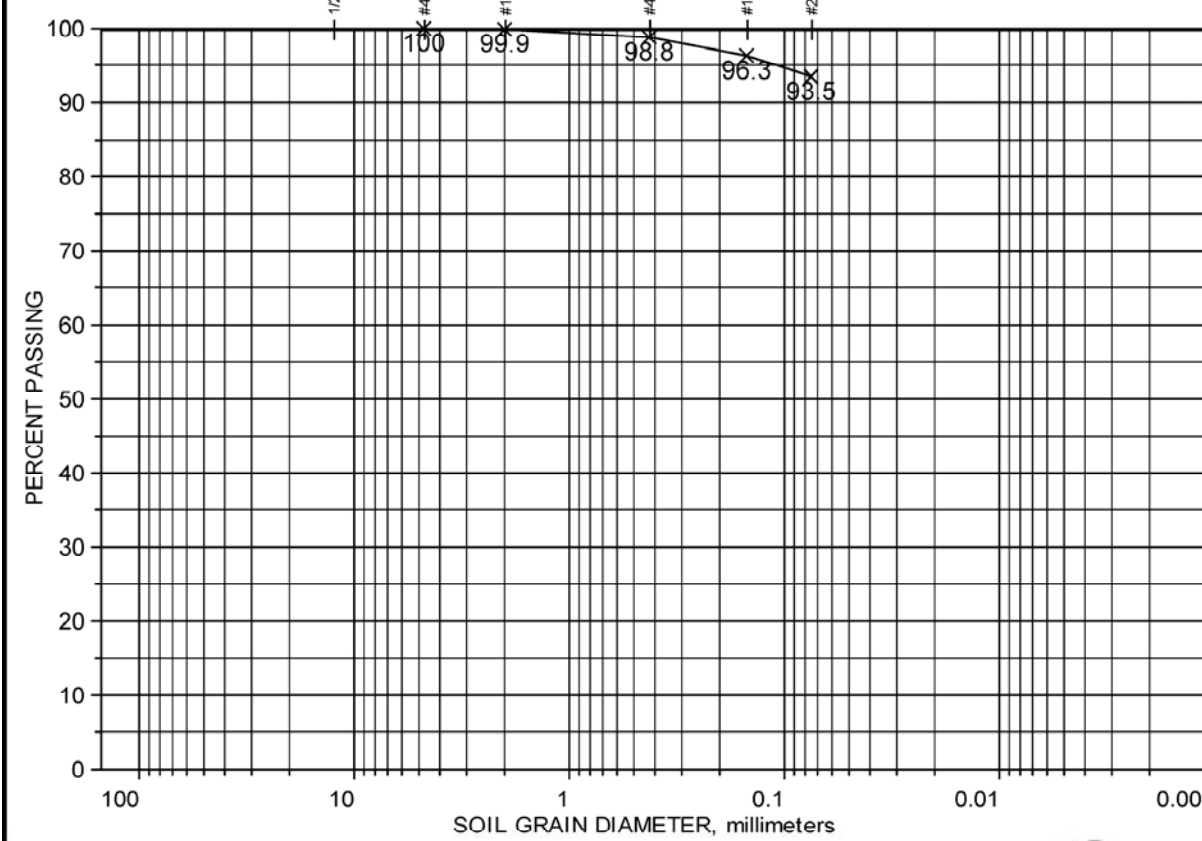

Reviewed by: *Andy Abre*



**16 MASS GRADING SUMMARY**

**Criteria Work**

Lot 9 in Block 2 of the Palouse Business Center were graded through the 2013 construction season. Mass grading was accomplished to the City of Pullman Standards, the Geotechnical Engineering Evaluation for Infrastructure prepared by STRATA and dated July 3, 2013, and the final Grading Plan prepared by Taylor Engineers and dated February 13, 2013. KIP Development retained STRATA to provide geotechnical continuity between design and construction; specifically to provide periodic testing and observation during earthwork operations. As the site was stripped of vegetation and organics, STRATA documented the subgrade conditions. Fill placement was monitored on a periodic basis as individual lifts were placed and compacted by the earthwork contractor. A nuclear densometer was used to perform random density and moisture tests for comparison to ASTM D1557 (Modified Proctor) and the structural fill specifications (92% of Modified Proctor). Density tests are valid for the specific location and depth tested. A sufficient number of tests and observations were performed to allow STRATA to verify that the fill placed met or exceeded the project specifications and therefore, can be relied on as structural fill. The test results and specific observations are retained in STRATA's and KIP's files and are recorded with the City of Pullman.

**Summary**

There are limitations that you should be aware of when relying on this earthwork data. The test locations were documented by GPS tied to the site survey and specific control points. However, handheld GPS has an estimated accuracy of +/- 20 feet laterally. The elevation of each test was estimated based on construction fill stakes and has an estimated accuracy of +/- 5 feet. The test data can change based on future construction disturbance, water infiltration, different instruments used to measure future density, and various other factors. Care in future earthwork is critical to realizing similarity between the density and moisture measurements performed during mass grading and future test results which you will rely on to meet project geotechnical and City of Pullman requirements. The structural fill embankments on your lots were, at all locations tested, compacted to between 92 and 95% of Modified Proctor. Finish subgrades at foundations, hardscapes, pavement and slab sections are required to achieve 95% compaction and therefore, some compaction effort should be expected by your contractor.

**ISSUED FOR**

- PRELIMINARY DESIGN USE
- PRELIMINARY REVIEW
- YOUR APPROVAL
- REFERENCE
- CONSTRUCTION
- DESTROY PREVIOUS PRINTS

REV	DATE	DESCRIPTION
1	1/10/14	DRAFT 90%
2	1/13/14	FINAL DESIGN
		KIP REVIEWED

DRAWN: CWS

DESIGN: TJW

CHECK: TJW

FILE: KIPDEV PU12186C

PROJECT:

PALOUSE BUSINESS CENTER  
 LOT 9 BLOCK 2  
 GRANDE RONDE COURT  
 PULLMAN, WASHINGTON 99163

PREPARED FOR:

KIP DEVELOPMENT  
 594 SOUTHEAST BISHOP  
 BOULEVARD #102  
 PULLMAN, WASHINGTON 99163

Attn: MR. KEVIN KIRKMAN



ENGINEER STAMP



6 O'Donnell Road,  
 Pullman, Washington 99163  
 Phone #: (509) 339-2000  
 Fax #: (509) 339-2001  
 www.stratageotech.com

